



FDCM60VNX-P,71VNX-P

Meaning of symbol

Symbol	Content
A	Water inlet port
B	Water outlet port
C	Cable draw-out hole (power cable)
D	Cable draw-out hole (signal wire)
E	Drain discharge hole
F	Anchor bolt hole $\phi 20 \times 3$ places
G	Hole for refrigerant leak check M10 $\times$ 4 places $\phi 60 \times 1$ place



Notes

- (1) It must not be surrounded by walls on the four sides.
- (2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
- (3) Where the unit is subject to strong winds, lay it in such a direction that the blower outlet face is perpendicular to the dominant wind direction.
- (4) Leave 1m or more space above the unit.
- (5) A wall in front of the blower outlet must not exceed the units height.
- (6) The model name label is attached on the service panel.

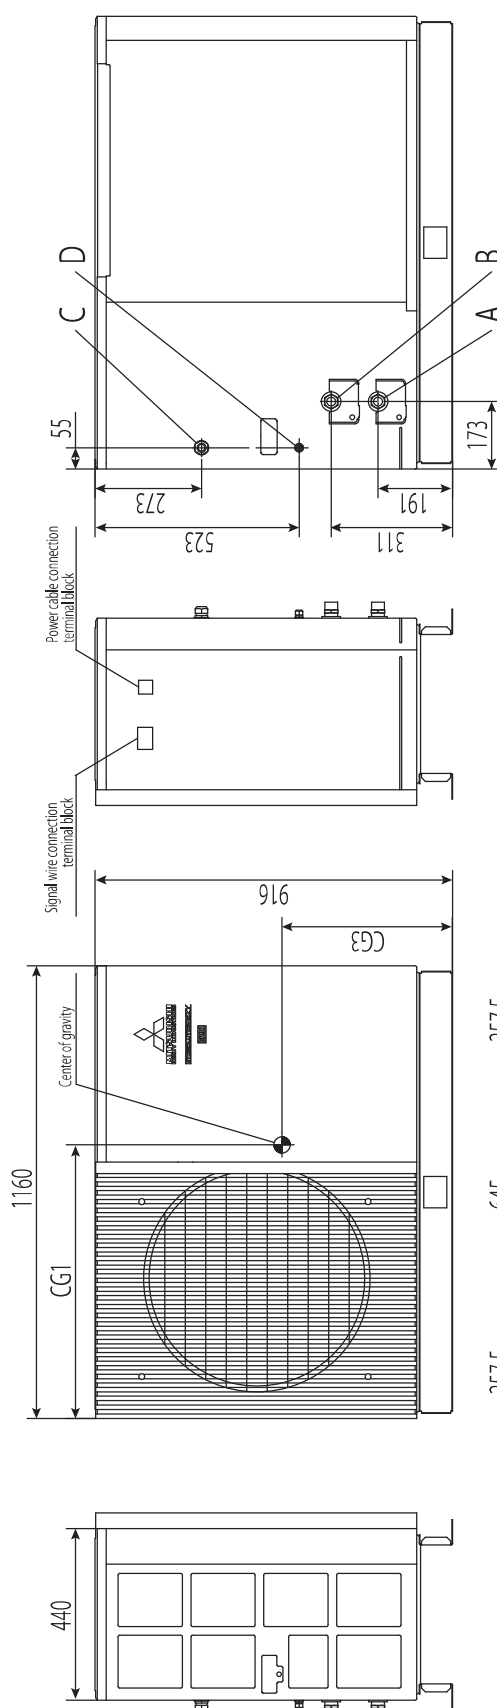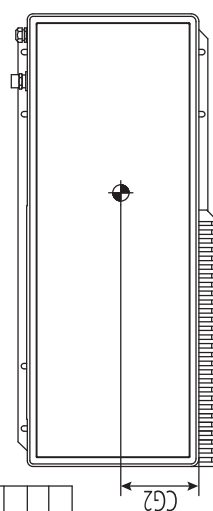

Examples of rectilinear Dimensions	Unit:mm		
	I	II	III
L1	Open	Open	500
L2	300	5 (*200)	Open
L3	150 (*200)	300	150 (*200)
L4	500	500	500

*Advisable to keep the space for easy maintenance.

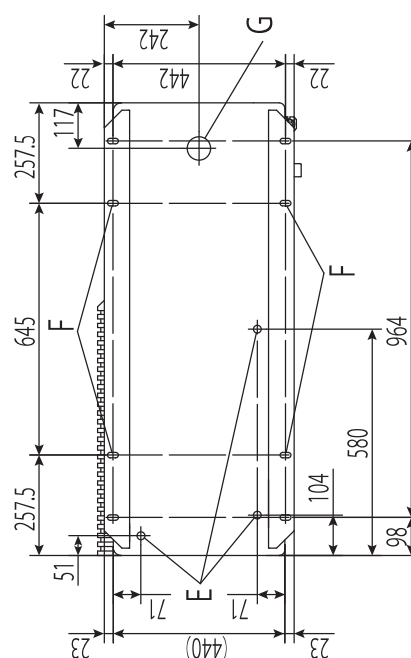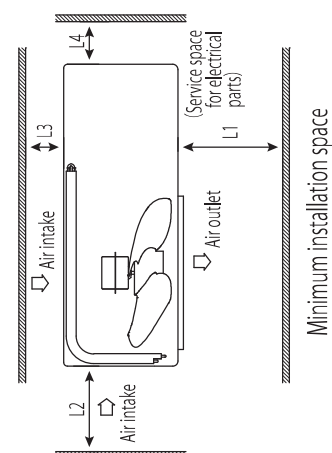

PCA002Z059