


Unit: mm

## Models SCM40ZS-W, 45ZS-W

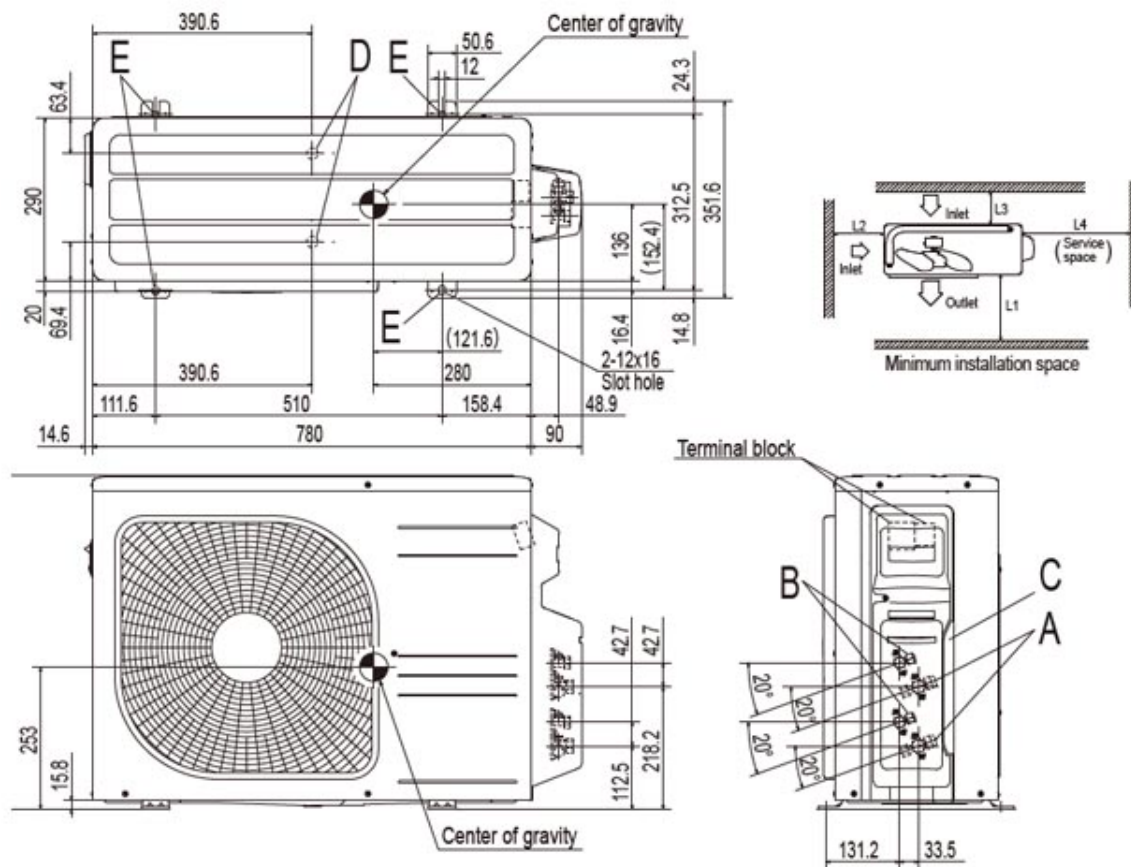

### Notes

- (1) The unit must not be surrounded by walls on the four sides.
- (2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
- (3) If the unit is installed in the location where there is a possibility of strong winds, place the unit such that the direction of air from the outlet gets perpendicular to the wind direction.
- (4) Leave 200mm or more space above the unit.
- (5) The wall height on the outlet side should be 1200mm or less.
- (6) The model name label is attached on the right side of the unit.

| Symbol | Content                                                           |
|--------|-------------------------------------------------------------------|
| A      | Service valve connection (gas side) $\phi 9.52 (3/8")$ (Flare)    |
| B      | Service valve connection (liquid side) $\phi 6.35 (1/4")$ (Flare) |
| C      | Pipe/cable draw-out hole                                          |
| D      | Drain discharge hole $\phi 20 \times 2$ places                    |
| E      | Anchor bolt hole M10-12x4 places                                  |

|    | Installation space |
|----|--------------------|
| L1 | 280 or more        |
| L2 | 100 or more        |
| L3 | 80 or more         |
| L4 | 250 or more        |