

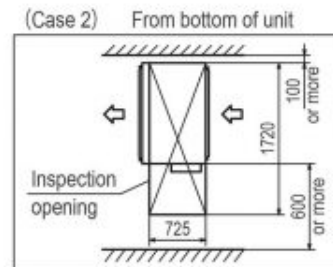
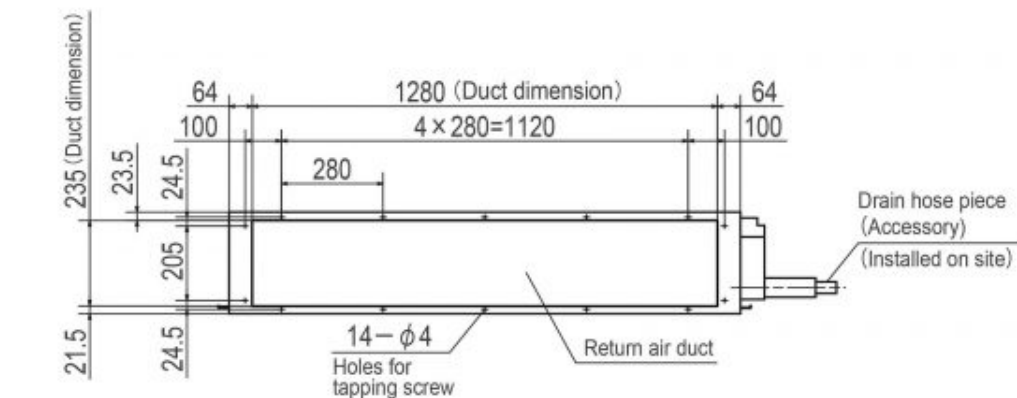



Models FDUM100VH,125VH,140VH

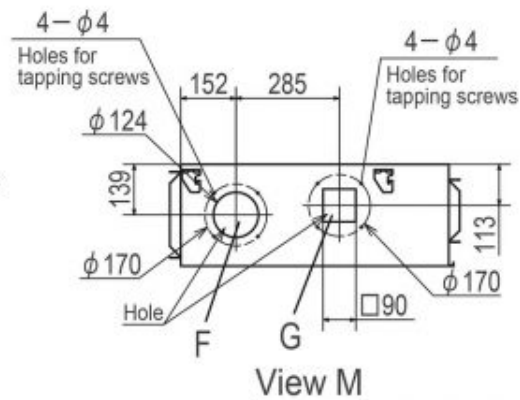

Note (1) The model name label is attached on the lid of the control box.

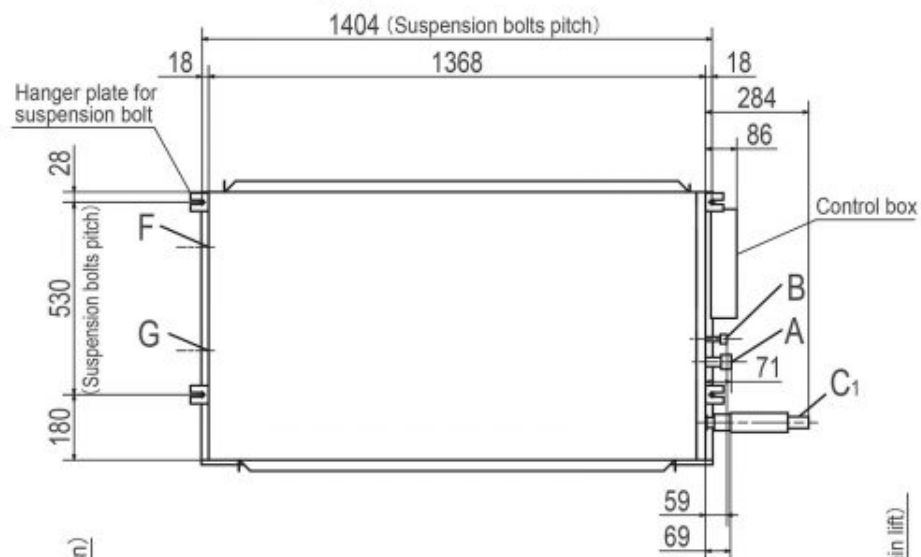

View M

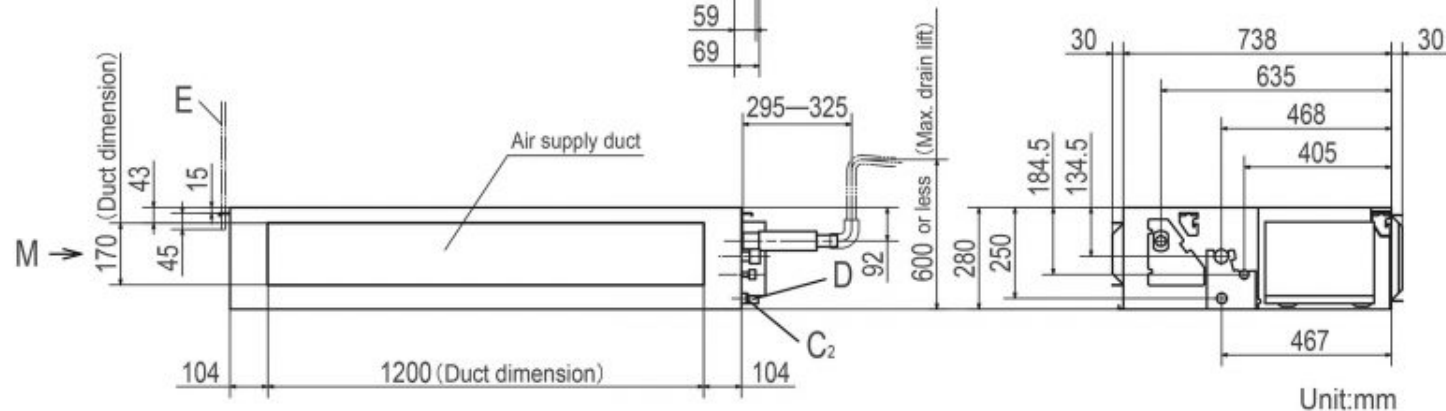


Unit:mm

Symbol	Content	
A	Gas piping	ϕ 15.88 (5/8") (Flare)
B	Liquid piping	ϕ 9.52 (3/8") (Flare)
C ₁	Drain piping	VP25 (O.D.32)
C ₂	Drain piping (Gravity drainage)	VP20
D	Hole for wiring	
E	Suspension bolts	(M10)
F	Outside air opening for ducting	(ϕ 150) (Knock out)
G	Air outlet opening for ducting	(ϕ 125) (Knock out)
H	Inspection opening	(450×450)

Space for installation and service

Select either of two cases to keep space for installation and services.

(Case 1) From side of unit

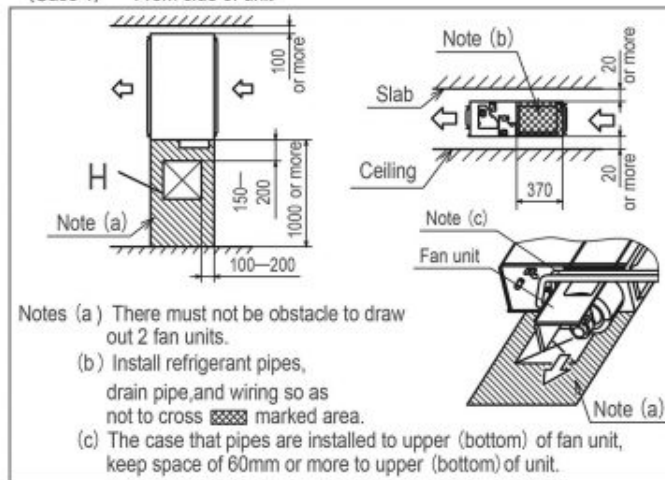

Notes (a) There must not be obstacle to draw out 2 fan units.

(b) Install refrigerant pipes, drain pipe, and wiring so as not to cross  marked area.

(c) The case that pipes are installed to upper (bottom) of fan unit, keep space of 60mm or more to upper (bottom) of unit.